

Rack Dimension

L	*	W	*	H
365	*	440	*	44 (1U) mm
14.4	*	17.3	*	1.73(1U) inch



■ Features

- Universal AC input / Full range
- 1U profile 19" rack shelf, fitting five 1600W modules up to 8000W with active current sharing
- Output voltage and current programmable
- Support hot swap (hot plug)
- Built-in PMBus protocol (Optional CANBus protocol)
- 5 years warranty

■ Applications

- Distributed power architecture system
- Wireless/telecommunication solution
- Electric vehicle or marine charger station
- DC UPS or emergency backup
- Wastewater treatment system
- Electrolysis system


■ Description

RHP-1U rack power system and RHB-1U rack charger system are the complete solution for the power distribution utilizing the rack configuration with the 1U low profile. Starting with a single unit of 1600W, RCP-1600 is the front end rectifier (or, power supply) and RCB-1600 is the charger module. With the active current sharing function, up to 8000W is able to be provided by 1 stack of the 19" rack mountable shelf RHP-1U, with either rectifier or charger, and 24000W by 3 stacks with rectifier.

■ Model Encoding


Rack Shelf:

RHP-1U I -A ☐

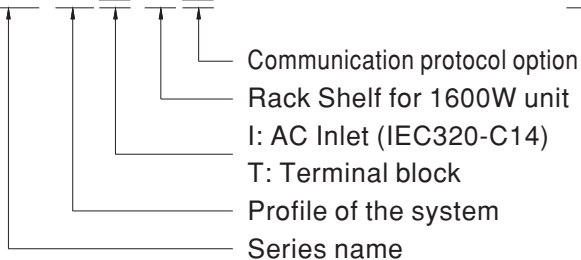

Whole System:

RHP-8K1U I -12 ☐

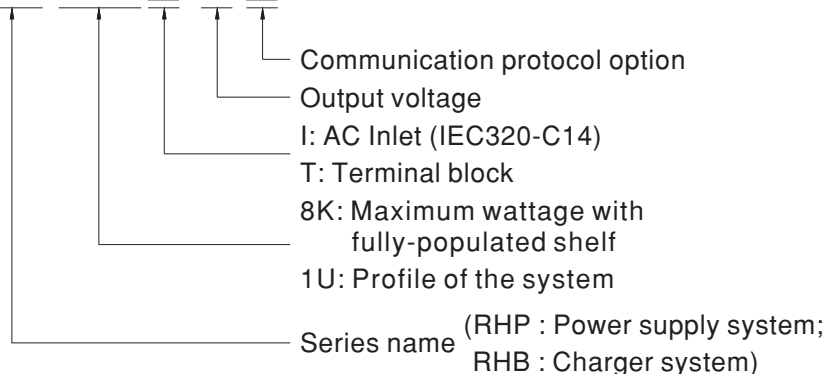

Type	Communication Protocol	Note
Blank	PMBus protocol	In Stock
CAN	CANBus protocol	By request



1600~8000W 1U Distributed Power/Charger System RHP-1U Rack System

SPECIFICATION - Power Supply System

MODEL		RHP-8K1U□-12		RHP-8K1U□-24		RHP-8K1U□-48	
OUTPUT	RECTIFIER	RCP-1600-12		RCP-1600-24		RCP-1600-48	
	RACK SHELF	RHP-1UI-A or RHP-1UT-A					
	OUTPUT VOLTAGE	12V		24V		48V	
	MAX. OUTPUT CURRENT	625A		335A		167.5A	
	MAX. OUTPUT POWER Note.5	7500W		8040W		8040W	
INPUT	VOLTAGE RANGE Note.6	90 ~ 264VAC 127 ~ 370VDC					
	FREQUENCY RANGE	47 ~ 63Hz					
	AC CURRENT (Typ.) per RECTIFIER	14A/115VAC 8A/230VAC		15A/115VAC 8.5A/230VAC		15A/115VAC 8.5A/230VAC	
	LEAKAGE CURRENT per RECTIFIER Note.8	<1.5mA / 230VAC					
FUNCTION	OUTPUT VOLTAGE PROGRAMMABLE(PV)	Adjustment of output voltage is allowable to 40 ~ 125% of nominal output voltage(60~125% for 12V). Please refer to the Function Manual.					
	CONSTANT CURRENT LEVEL PROGRAMMABLE(PC)	Adjustment of constant current level is allowable to 20 ~ 100% of rated current. Please refer to the Function Manual.					
	REMOTE ON-OFF CONTROL	By electrical signal or dry contact ON:short OFF:open					
	REMOTE SENSE	Compensate voltage drop on the load wiring up to 0.5V					
	AUXILIARY POWER	5V @ 0.3A, 12V @ 0.8A					
	ALARM SIGNAL	Isolated TTL signal output for T-Alarm, AC-OK and DC-OK					
ENVIRONMENT	WORKING TEMP.	-30 ~ +70℃ (Refer to "Derating Curve")					
	WORKING HUMIDITY	20 ~ 90% RH non-condensing					
	STORAGE TEMP., HUMIDITY	-40 ~ +85℃, 10 ~ 95% RH non-condensing					
	TEMP. COEFFICIENT	±0.03%/℃ (0 ~ 50℃)					
	VIBRATION	10 ~ 500Hz, 2G 10min./1cycle, 60min. each along X, Y, Z axes					
SAFETY & EMC (Note 4)	SAFETY STANDARDS	UL60950-1, TUV EN60950-1, EAC TP TC 004 approved					
	WITHSTAND VOLTAGE	I/P-O/P:3KVAC I/P-FG:2KVAC O/P-FG:1.5KVAC (0.5KVAC for 12V)					
	ISOLATION RESISTANCE	I/P-O/P, I/P-FG, O/P-FG:100M Ohms / 500VDC / 25℃ / 70% RH					
	EMC EMISSION	Parameter	Standard			Test Level / Note	
		Conducted	EN55032 (CISPR32) / EN55011 (CISPR11)			Class B	
		Radiated	EN55032 (CISPR32) / EN55011 (CISPR11)			Class A	
		Harmonic Current	EN61000-3-2			Class A	
		Voltage Flicker	EN61000-3-3			-----	
	EMC IMMUNITY	EN55024 , EN61204-3, EN61000-6-2					
		Parameter	Standard			Test Level / Note	
		ESD	EN61000-4-2			Level 3, 8KV air ; Level 2, 4KV contact	
		Radiated	EN61000-4-3			Level 3	
		EFT / Burst	EN61000-4-4			Level 3	
		Surge	EN61000-4-5			Level 4, 2KV/Line-Line 4KV/Line-Earth	
		Conducted	EN61000-4-6			Level 3	
		Magnetic Field	EN61000-4-8			Level 4	
		Voltage Dips and Interruptions	EN61000-4-11			>95% dip 0.5 periods, 30% dip 25 periods, >95% interruptions 250 periods	
OTHERS	DIMENSION	Rack 365*482.6*44(L*W*H, with mounting bracket) ; 365*440*44(L*W*H, without mounting bracket)					
	PACKING	5.5Kg; 3pcs/17.5Kg/2.11CUFT					
NOTE	1. All parameters NOT specially mentioned are measured at 230VAC input, rated load and 25℃ of ambient temperature. 2. Ripple & noise are measured at 20MHz of bandwidth by using a 12" twisted pair-wire terminated with a 0.1uf & 47uf parallel capacitor. Under parallel operation of more than one rack connecting together, ripple of the output voltage may be higher than the SPEC at light load condition. It will go back to normal ripple level once the output load is more than 5%. 3. Tolerance : includes set up tolerance, line regulation and load regulation. 4. The power supply is considered a component which will be installed into a final equipment. All the EMC tests are been executed by mounting the unit on a 1000mm*1300mm metal plate with 1mm of thickness. The final equipment must be re-confirmed that it still meets EMC directives. For guidance on how to perform these EMC tests, please refer to "EMI testing of component power supplies." (as available on http://www.meanwell.com) 5. Output of all the RCP-1600 modules are connected in parallel in the rack. 6. Derating may be needed under low input voltages. Please check the static characteristics for more details. 7. Because of component tolerance, there is a possibility that some of units connected in parallel will reach an overcurrent limit then overloading the other units when operating at full load condition. If overload conditions happen in parallel usage, it is suggested that derate the total output current by 10%. 8. The equivalent leakage current of the system is determined by the quantity of populated rectifiers. 9. The ambient temperature derating of 3.5℃/1000m with fanless models and of 5℃/1000m with fan models for operating altitude higher than 2000m(6500ft).						

**SPECIFICATION - Charger System**


MODEL		RHB-8K1U□-12		RHB-8K1U□-24		RHB-8K1U□-48	
OUTPUT	CHARGER	RCB-1600-12		RCB-1600-24		RCB-1600-48	
	RACK SHELF	RHP-1UI-A or RHP-1UT-A					
	BOOST CHARGE VOLTAGE(Vboost)(default)	14.4V		28.8V		57.6V	
	FLOAT CHARGE VOLTAGE(Vfloat)(default)	13.8V		27.6V		55.2V	
	CURRENT RANGE	0 ~ 500A		0 ~ 275A		0 ~137.5A	
INPUT	VOLTAGE RANGE	Note.2 90 ~ 264VAC 127 ~ 370VDC					
	FREQUENCY RANGE	47 ~ 63Hz					
	AC CURRENT (Typ.) per CHARGER	14A/115VAC 8A/230VAC		15A/115VAC 8.5A/230VAC		15A/115VAC 8.5A/230VAC	
	LEAKAGE CURRENT per CHARGER	Note.5 <1.5mA / 230VAC					
	FUNCTION	Adjustment of output voltage is allowable to 75 ~ 125% of nominal output voltage. Please refer to the Function Manual.					
FUNCTION	OUTPUT VOLTAGE PROGRAMMABLE(PV)	Adjustment of output voltage is allowable to 20 ~ 100% of rated current. Please refer to the Function Manual.					
	OUTPUT CURRENT PROGRAMMABLE(PC)	By electrical signal or dry contact ON:short OFF:open					
	REMOTE ON-OFF CONTROL	5V @ 0.3A, 12V @ 0.8A					
	AUXILIARY POWER	The isolated TTL signal out, Please refer to Installation Manual					
	ALARM SIGNAL	-3mV / °C / cell / (12V = 6 cells ; 24V = 12 cells ; 48V = 24 cells)					
ENVIRONMENT	TEMPERATURE COMPENSATION	-30 ~ +70℃ (Refer to "Derating Curve")					
	WORKING TEMP.	20 ~ 90% RH non-condensing					
	WORKING HUMIDITY	-40 ~ +85℃ , 10 ~ 95% RH non-condensing					
	STORAGE TEMP., HUMIDITY	±0.03%/℃ (0 ~ 50℃)					
	TEMP. COEFFICIENT	10 ~ 500Hz, 2G 10min./1cycle, 60min. each along X, Y, Z axes					
SAFETY & EMC (Note 4)	VIBRATION	UL60950-1, TUV EN60950-1, EAC TP TC 004 approved					
	SAFETY STANDARDS	I/P-O/P:3KVAC I/P-FG:2KVAC O/P-FG:1.5KVAC (0.5KVAC for 12V)					
	WITHSTAND VOLTAGE	I/P-O/P, I/P-FG, O/P-FG:100M Ohms / 500VDC / 25℃ / 70% RH					
	ISOLATION RESISTANCE	Compliance to EN55032 (CISPR32) Conduction Class B, Radiation Class A ; EN61000-3-2,-3, EAC TP TC 020					
	EMC EMISSION	Compliance to EN61000-4-2,3,4,5,6,8,11, EN61000-6-2 (EN50082-2), Heavy industry level, criteria A, EAC TP TC 020					
OTHERS	EMC IMMUNITY	Rack 365*482.6*44(L*W*H, with mounting bracket) ; 365*440*44(L*W*H, without mounting bracket)					
	DIMENSION	5.5Kg; 3pcs/17.5Kg/2.11CUFT					
NOTE	PACKING	1. All parameters NOT specially mentioned are measured at 230VAC input, rated load and 25℃ of ambient temperature. 2. Derating may be needed under low input voltages. Please check the static characteristics for more details. 3. The power supply is considered a component which will be installed into a final equipment. All the EMC tests are been executed by mounting the unit on a 1000mm*1300mm metal plate with 1mm of thickness. The final equipment must be re-confirmed that it still meets EMC directives. For guidance on how to perform these EMC tests, please refer to "EMI testing of component power supplies." (as available on http://www.meanwell.com) 4. Output of all the RCB-1600 modules are connected in parallel in the rack. 5. The equivalent leakage current of the system is determined by the quantity of populated chargers. 6. The ambient temperature derating of 3.5℃/1000m with fanless models and of 5℃/1000m with fan models for operating altitude higher than 2000m(6500ft).					

Function Manual

1. Voltage Drop Compensation (Only for power supply system)


1.1 Remote Sense

The remote sense compensates voltage drop on the load wiring up to 0.5V.

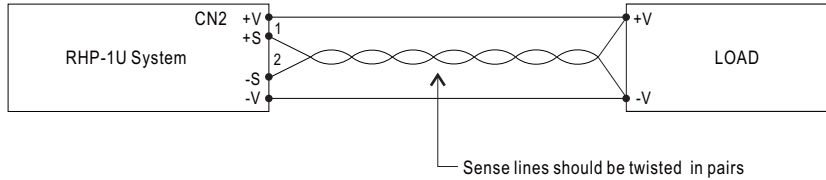


1.2 Local Sense

Notice : The +S,-S have to be connected to the +V(signal),-V(signal), respectively, in order to get the correct output voltage if the remote sensing is not used.



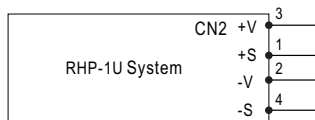


2. Output Voltage Programming (or, PV / remote voltage programming / remote adjust / margin programming / dynamic voltage trim)

※ In addition to the adjustment via the built-in potentiometer, the output voltage can be trimmed by applying EXTERNAL VOLTAGE.

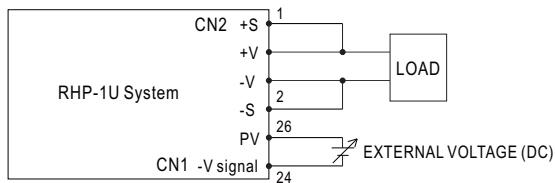


+S & +V, -S & -V also need to be connected on CN1. (Only for power supply system)

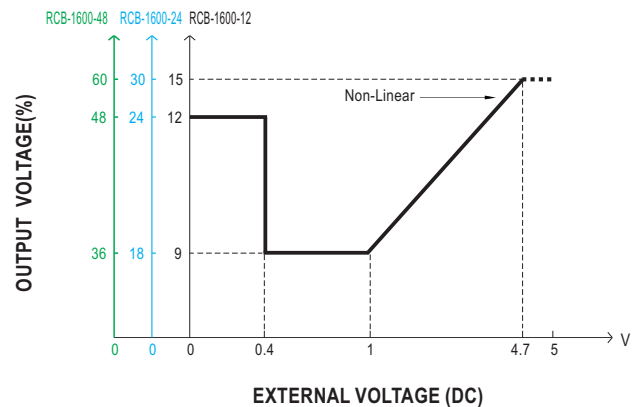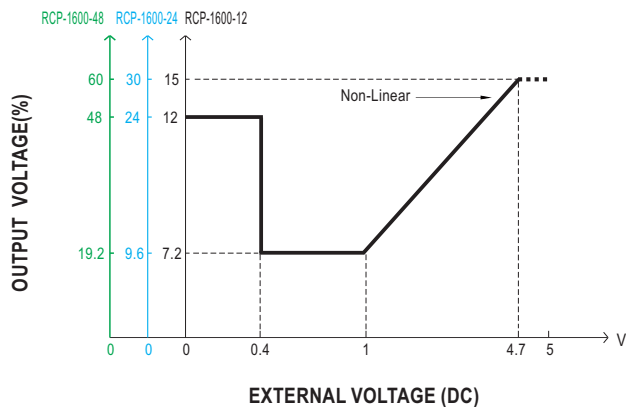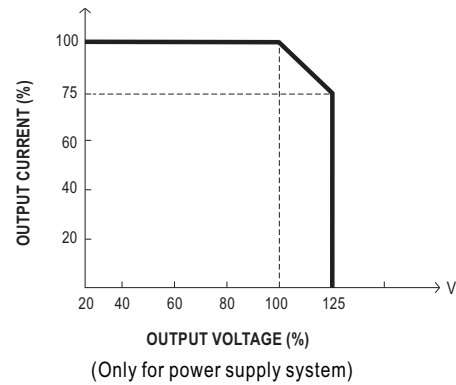


3. Output Current Programming (or, PC / remote current programming / dynamic current trim)


※ The output current can be trimmed to 20~100% of the rated current by applying EXTERNAL VOLTAGE.

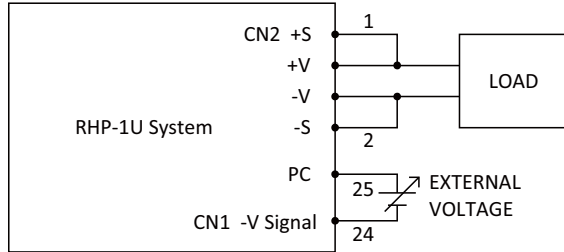

+S & +V, -S & -V also need to be connected on CN1. (Only for power supply system)

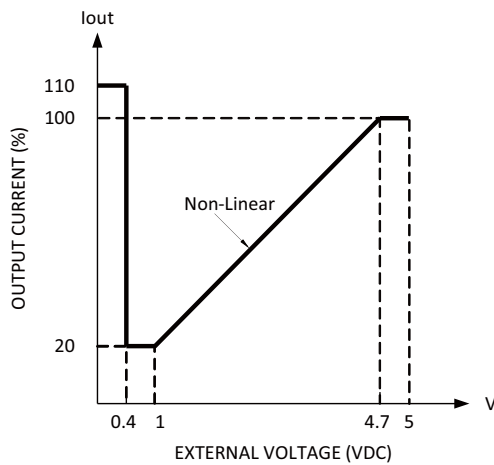



⊙ For power supply system

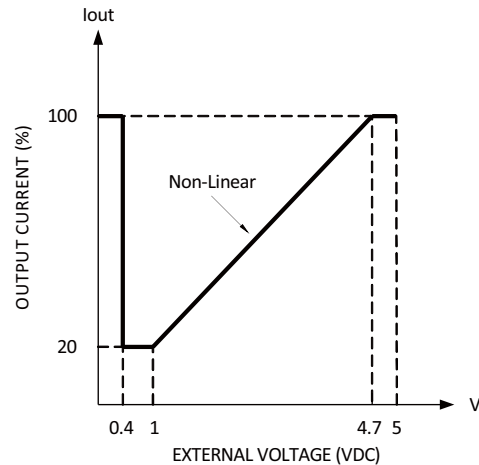

⊙ For charger system

4. Remote ON-OFF Control

The PSU can be turned ON/OFF together or separately by using the "Remote ON/OFF" function.




Between ON/OFF and +5V-AUX	Output
SW Open	OFF
SW Short	ON

5. PMBus Communication Interface

RCP-1600/RCB-1600 supports PMBus Rev. 1.1 with maximum 100KHz bus speed, allowing information reading, status monitoring, output trimming, etc. For details, please refer to the Function Manual.


■ Mechanical Specification

Case No.242A Unit:mm

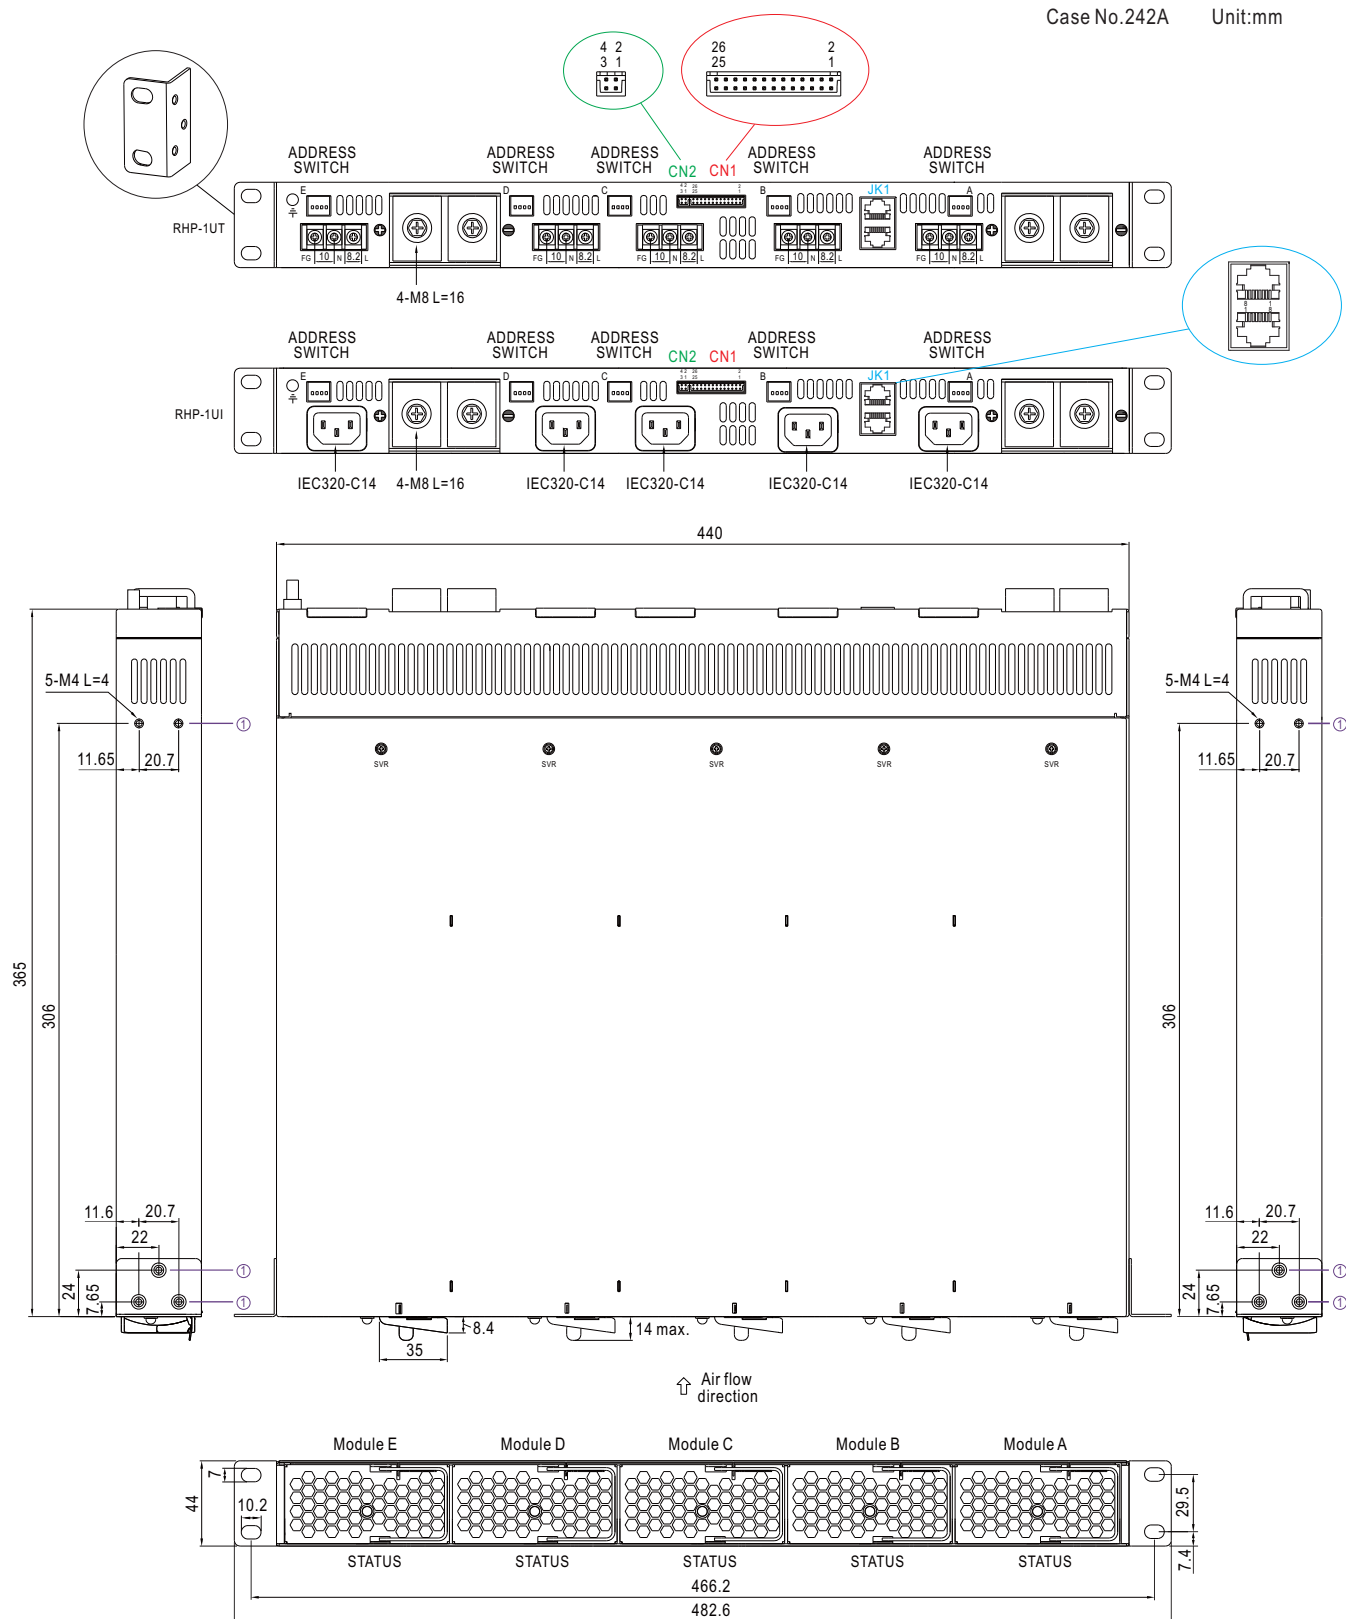

※ Mounting Instruction

Hole No.	Recommended Screw Size	MAX. Penetration Depth L	Recommended mounting torque
①	M4	4mm	7~10Kgf-cm

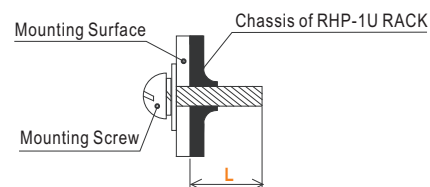

※ LED Status Indicators & Corresponding Signal at Function Pins


◎ For power supply system

LED	Description
Green	The power supply functions normally.
Red	The LED will present a constant red light when the abnormal status (OTP, OLP, fan fail and charging timeout) arises.
Red (Flashing)	The LED will flash with the red light when the internal temperature reaches 60°C; under this condition, the unit still operates normally without entering OTP. (In the meantime, an alarm signal will be sent out through the PMBus interface.)

◎ For charger system

LED	Description
Green	Float (stage 3)
Orange	Charging (stage 1 or stage 2)
Red	The LED will present a constant red light when the abnormal status (OTP, OLP, fan fail and charging timeout) arises.
Red (Flashing)	The LED will flash with the red light when the internal temperature reaches 60°C; under this condition, the unit still operates normally without entering OTP. (In the meantime, an alarm signal will be sent out through the PMBus interface.)

※ Connector Pin No. Assignment(CN1) : HRS DF11-26DP-2DS




Mating Housing	HRS DF11-26DS or equivalent
Terminal	HRS DF11-26SC or equivalent

Pin No.	Function	Description
1,5,9,13,17	AC-OK	High (4.5 ~ 5.5V) : When the input voltage is $\geq 87V_{rms}$. Low (-0.1 ~ 0.5V) : When the input voltage is $\leq 75V_{rms}$. The maximum sourcing current is 10mA and only for output. (Note.2)
2,6,10,14,18	DC-OK	For power supply system High (4.5 ~ 5.5V) : When the $V_{out} \leq 80\% \pm 5\%$. Low (-0.1 ~ 0.5V) : When $V_{out} \geq 80\% \pm 5\%$. The maximum sourcing current is 10mA and only for output. (Note.2) For charger system High (4.5 ~ 5.5V) : When the $V_{out} \leq 8V/16V/32V \pm 1V$. Low (-0.1 ~ 0.5V) : When $V_{out} \geq 8V/16V/32V \pm 1V$. The maximum sourcing current is 10mA and only for output. (Note.2) DC OK is associated with battery low protection.
3,7,11,15,19	Remote ON-OFF	The unit can turn the output ON/OFF by electrical signal or dry contact between Remote ON-OFF and +5V-AUX. (Note.2) Short (4.5 ~ 5.5V) : Power ON ; Open (0 ~ 0.5V) : Power OFF ; The maximum input voltage is 5.5V.
4,8,12,16,20	T-ALARM	High (4.5 ~ 5.5V) : When the internal temperature exceeds the limit of temperature alarm, or when fan fails. Low (-0.1 ~ 0.5V) : When the internal temperature is normal, and when fan normally works. The maximum sourcing current is 10mA and only for output(Note.2)
21	+5V-AUX	Auxiliary voltage output, 4.5~5.5V, referenced to GND-AUX (pin 22). The maximum load current is 0.3A. This output has the built-in "Oring diodes" and is not controlled by the remote ON/OFF control.
22	GND-AUX	Auxiliary voltage output GND. The signal return is isolated from the output terminals (+V & -V).
23	+12V-AUX	Auxiliary voltage output, 10.8~13.2V, referenced to GND-AUX (pin 22). The maximum load current is 0.8A. This output has the built-in "Oring diodes" and is not controlled by the remote ON/OFF control.
24	-V(Signal)	Negative output voltage. For local sense use only; It can't be connected directly to the load.
25	PC	Connection for output current programming. The current can be trimmed within its defined range. (Note.1)
26	PV	Connection for output voltage programming. The voltage can be trimmed within its defined range. (Note.1)

Note.1: Non-isolated signal, referenced to [-V(signal)].

Note.2: Isolated signal, referenced to GND-AUX.

※ Connector Pin No. Assignment(CN2) : HRS DF11-4DP-2DS



Mating Housing	HRS DF11-4DS or equivalent
Terminal	HRS DF11-4SC or equivalent


◎ For power supply system

1	+S	Positive sensing. The +S signal should be connected to the positive terminal of the load. The +S and -S leads should be twisted in pair to minimize noise pick-up effect. The maximum line drop compensation is 0.5V.
2	-S	Negative sensing. The -S signal should be connected to the negative terminal of the load. The -S and +S leads should be twisted in pair to minimize noise pick-up effect. The maximum line drop compensation is 0.5V.
3	+V(Signal)	Positive output voltage. For local sense use only, can't be connected directly to the load.
4	-V(Signal)	Negative output voltage. For local sense use only, can't be connected directly to the load.

◎ For charger system

1	RTH+	Temperature sense associated with the temperature compensation function.
2	RTH-	
3,4	NC	Not use.

※ Connector Pin No. Assignment(JK1) : RJ45 8 positions



Pin No.	Function	Description
1,2	DA,DB	Differential digital signal for parallel control. (Note.1)
3	-V(signal)	Negative output voltage signal. It is for local sense and certain function reference; it cannot be connected directly to the load.
4	CONTROL	Remote ON-OFF control pin used in the PMBus interface. (Note.2)
5	NC	Retain for future use.
6	SDA	For PMBus model: Serial Data used in the PMBus interface. (Note.2)
	CANH	For CANBus model: Data line used in CANBus interface. (Note.2)
7	SCL	For PMBus model: Serial Clock used in the PMBus interface. (Note.2)
	CANL	For CANBus model: Data line used in CANBus interface. (Note.2)
8	GND-AUX	Auxiliary voltage output GND. The signal return is isolated from the output terminals (+V & -V).

Note.1: Non-isolated signal, referenced to [-V(signal)].

Note.2: Isolated signal, referenced to GND-AUX.



Declaration of Conformity

For the following equipment :

Product Name: Switching Power Supply

Model Designation: RHP-8K1Uy-X (y= I, T ,CAN or blank ; X=12,24,48) ;

RHB-8K1U y-X (y= I, T ,CAN or blank ; X=12,24,48) ; RCP-1600-xy (x=12,24,48;y=blank or CAN) ;

RCB-1600-xy (x=12,24,48 ; y=I, T , CAN or blank) ; RCB-1600-zNE(z=12,24) ; RHP-1Uy-A (y=I,T,CAN or blank)

is herewith confirmed to comply with the requirements set out in the Council Directive, the following standards were applied :

RoHS Directive (2011/65/EU), (EU)2015/863

Low Voltage Directive (2014/35/EU) :

EN 62368-1:2014+A11

TUV certificate No : R50454758

Electromagnetic Compatibility Directive (2014/30/EU) :

EMI (Electro-Magnetic Interference)

Conducted emission EN55032:2015

Class B

Radiated emission EN55032:2015

Class A

Harmonic current EN61000-3-2:2014

Voltage flicker EN61000-3-3:2013

EMS (Electro-Magnetic Susceptibility)

EN55024:2010+A1:2015

ESD air EN61000-4-2:2009

Level 3 8KV

ESD contact EN61000-4-2:2009

Level 2 4KV

RF field susceptibility EN61000-4-3:2006+A1:2008+A2:2010

Level 3 10V/m

EFT bursts EN61000-4-4:2012

Level 3 2KV/5KHz

Surge susceptibility EN61000-4-5:2014

Level 4 2KV/Line-Line

Surge susceptibility EN61000-4-5:2014

Level 4 4KV/Line-Earth

Conducted susceptibility EN61000-4-6:2014

Level 3 10V

Magnetic field immunity EN61000-4-8:2010

Level 4 30A/m

Voltage dip, interruption EN61000-4-11:2004 >95% dip 0.5 periods 30% dip 25 periods >95% interruptions 250 periods

Note:

A component power supply with load will be installed into final equipment which consists of an electronically shielded metal enclosure. Since EMC performance will be affected by the complete installation, the final equipment manufacturers must re-qualify EMC Directive on the complete installation again.

The EMC tests mentioned above are performed using a well defined metal plate to simulate said metal enclosure.

For guidance on how to perform these EMC tests, please refer to "EMI testing of component power supplies".(as available on <http://www.meanwell.com>)".

This Declaration is effective from serial number RB9xxxxxx

Person responsible for marking this declaration :

MEAN WELL Enterprises Co., Ltd.

(Manufacturer Name)

No.28, Wuquan 3rd Rd., Wugu Dist., New Taipei City 24891, Taiwan

(Manufacturer Address)

Johnny Huang/Manager, Certification Center :

(Name / Position)

(Signature)

Alex Tsai/Director, Marketing Department :

(Name / Position)

(Signature)

Taiwan

(Place)

Dec. 18th, 2019

(Date)